

Precast Reinforced Concrete Transformer Pads



1. Scope

This standard covers the detailed requirements for precast reinforced concrete transformer pads.

This standard applies to the following Seattle City Light (SCL) stock numbers:

Stock No	Description
013721	Single phase transformer pad
013723	Three phase transformer pad (500–1500 kVA)
013724	Three phase transformer pad (2000–2500 kVA)

2. Application

Precast reinforced concrete transformer pads are used as a platform for transformers or switchgear.

If a precast or cast-in-place oil containment system is installed separately from the transformer pad, see SCL 0724.50 for installation details.

Due to their size, transformer pads will not be stocked in SCL inventory. Engineers and the Civil Crew Chief are required to order and specify delivery of these items.

Single-phase, pad-mounted transformers and their pads are only for replacing existing facilities that have failed in service. This material is not for new construction.

This standard is to be used in conjunction with the latest revision of SCL 7203.21.

Standard Coordinator
Chad Rehahn

Standards Engineering Supervisor
Brett Hanson

Division Director
Bob Risch

3. Requirements, General

Pad grounding shall comply with SCL 7203.21.

Transformer pads shall be constructed according to the dimensions and details shown in Table 3.2 and Figure 3.2a.

For all transformer pads except for Stock No. 013274, the letters "SCL," measuring 3-in high, shall be cast into the top side of the pad.

Lift inserts measuring 3/4-inch in diameter (nominal) shall be located at each corner on the top side of the pad.

Caps shall cover each lift insert.

For Stock No. 013724, knockout panels measuring 6 in x 24 in shall be installed on each side of the blockout. See Figure 3.2b.

Table 3.2. Pad Dimensions

Stock No.	Dimensions, nominal (ft-in)			Blockout Dimensions, nominal (in)		Blockout placement from edge of pad (in)
	Width	Length	Height	Width	Length	
	W _p	L _p	H _p	W _b	L _b	Q
013721	4-0	4-8	0-6	22	14	8
013723	8-0	7-9	0-6	60	16	12
013724	8-0	10-0	0-8	72	24	12

Figure 3.2a. Transformer Pad


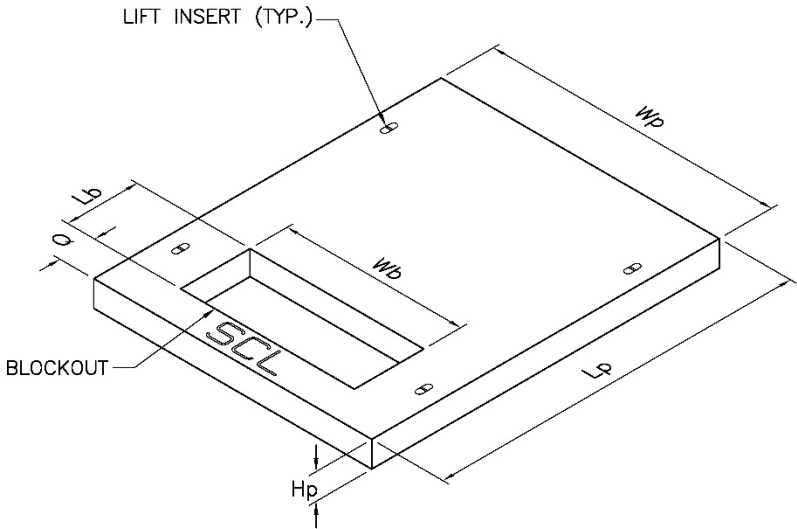


Figure 3.2b. Knockout Panel Detail, Stock No. 013724

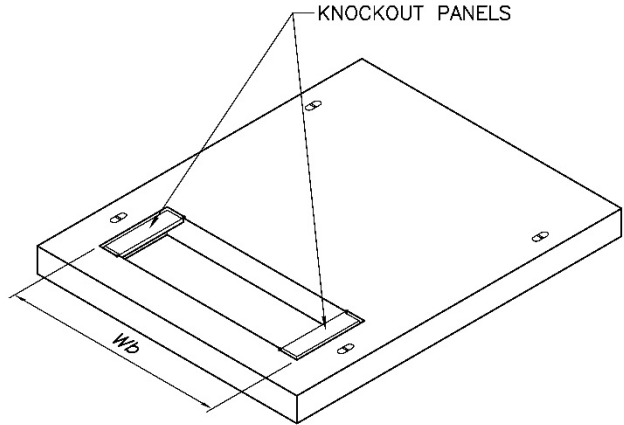

4. Issuance

Unit: EA

5. Approved Manufacturers

Stock No.	Description	Oldcastle Utility Vault Catalog No.
013721	Single phase transformer pad	54-1422
013723	Three phase transformer pad (500–1500 kVA)	88-1660
013724	Three phase transformer pad (2000–2500 kVA)	77-810-2460

6. References

SCL Construction Standard 0724.50; “Customer Requirements for Padmount Transformer Services, Looped Radial System”

SCL Material Standard 7203.21; “Precast Reinforced Concrete Structure, General”

7. Sources

Ng, Sharon; SCL Civil Engineer and subject matter expert for 7203.76

Wang, Quan; SCL Standards Engineer, originator, and subject matter expert for 7203.76